




DOOR SCHEDULE

DOOR TYPE	TYPE "A"	TYPE "B"	TYPE "C"						
WALL	150mm BRICKWALL	150mm BRICKWALL	150mm BRICKWALL						
REF. NO	REF. NO	LOCATION	LOCATION						
D02	BEDROOM 2	LH	D07	KITCHEN	LH	D08	LIVING	SLIDING	
D03	MAIN BEDROOM	LH							
D04	ENSUITE	RH							
D05	BATHROOM	RH							
D06	BEDROOM 1	LH							
NO. REQ	FIVE (05)			ONE (01)			ONE (01)		
FRAME	GALV. PRESSED STEEL DOOR FRAME 15mm THICK FOR 150mm WALL.			GALV. PRESSED STEEL DOOR FRAME 15mm THICK FOR 150mm WALL.			STANDARD ANODIZED ALUM. FRAME WITH BEADINGS. FRAMES FITTED AFTER BRICKWORK.		
LEAF	813 x 2032 x 44mm SEMI SOLID CORE FLUSH PANEL DOOR. WITH HARDWOOD EDGING.			813 x 2032 x 44mm SOLID CORE STABLE DOOR.			1800 x 2100 SLIDING DOOR.		
FINISH	1 CT PINK WIPRIMER & 2 CTS SUPER ENAMEL.			SANDICED & 3 COATS OF CLEAR VARNISH.			6mm CLEAR SAFETY GLASS (SANS 10400 PART N)		
I/MONGERY	1 DOVE LEVER HANDLES 2 LEVER MORTICE LOCKSET.			1 DOVE LEVER HANDLES 2 LEVER MORTICE LOCKSET.					

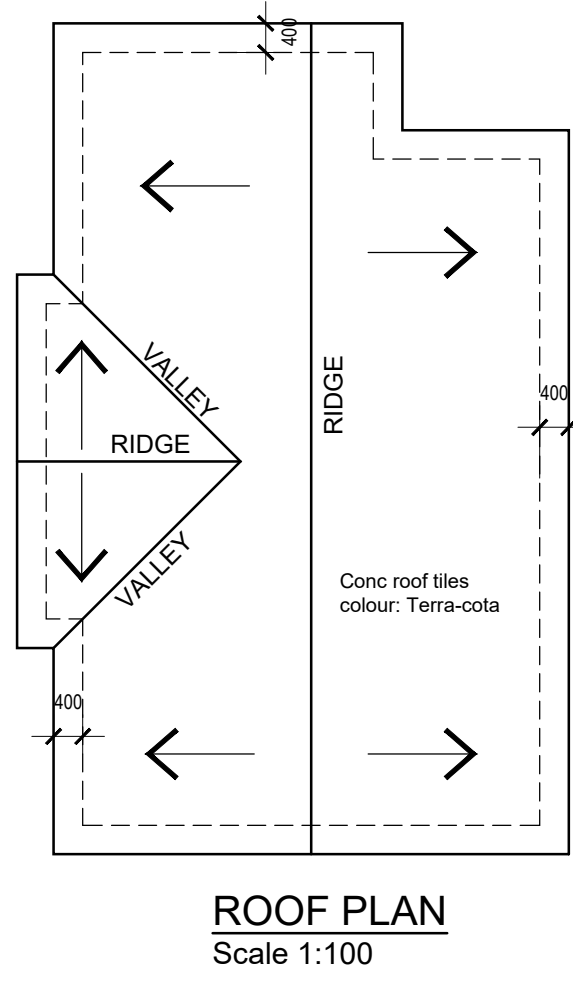

WINDOW SCHEDULE

TYPE: PTT1515	TYPE: PT99		
QTTY: FOUR (04)	QTTY: THREE (03)		
LOCATION	ORIENTATION	LOCATION	ORIENTATION
LIVING ROOM	SOUTH EAST ELEVATION	BATHROOM	SOUTH WEST ELEVATION
MAIN BEDROOM	NORTH EAST ELEVATION	KITCHEN	SOUTH WEST ELEVATION
BEDROOM 1	SOUTH WEST ELEVATION	ENSUITE	NORTH WEST ELEVATION
BEDROOM 2	NORTH EAST ELEVATION		
FRAME DESCRIPTION	STANDARD ANODIZED ALUM. FRAME COMPLETE WITH BEADING. WINDOW FRAMES TO BE FITTED AFTER THE BRICKWORK ALL AS PER THE MANUF. SPECS.		
FINISH	ANODIZED.		
GLAZING	GLAZING		
ALL GLASS PANES TO BE SAFETY GLASS AS PER SANS 10400 PART N. 6MM CLEAR TOUGHENED SAFETY GLASS BEADINGS TO BE USED TO FIX GLASS INTO POSITION.			

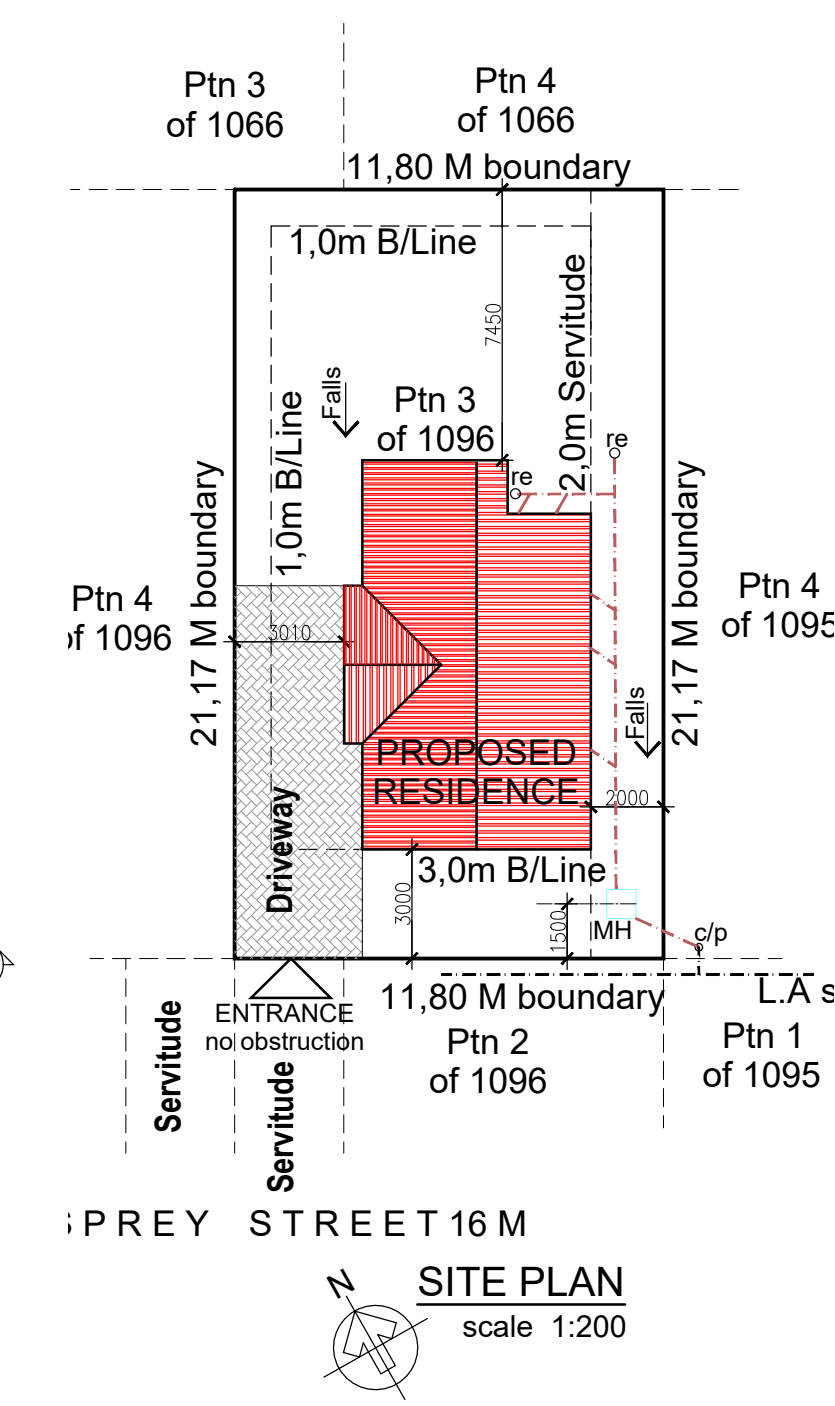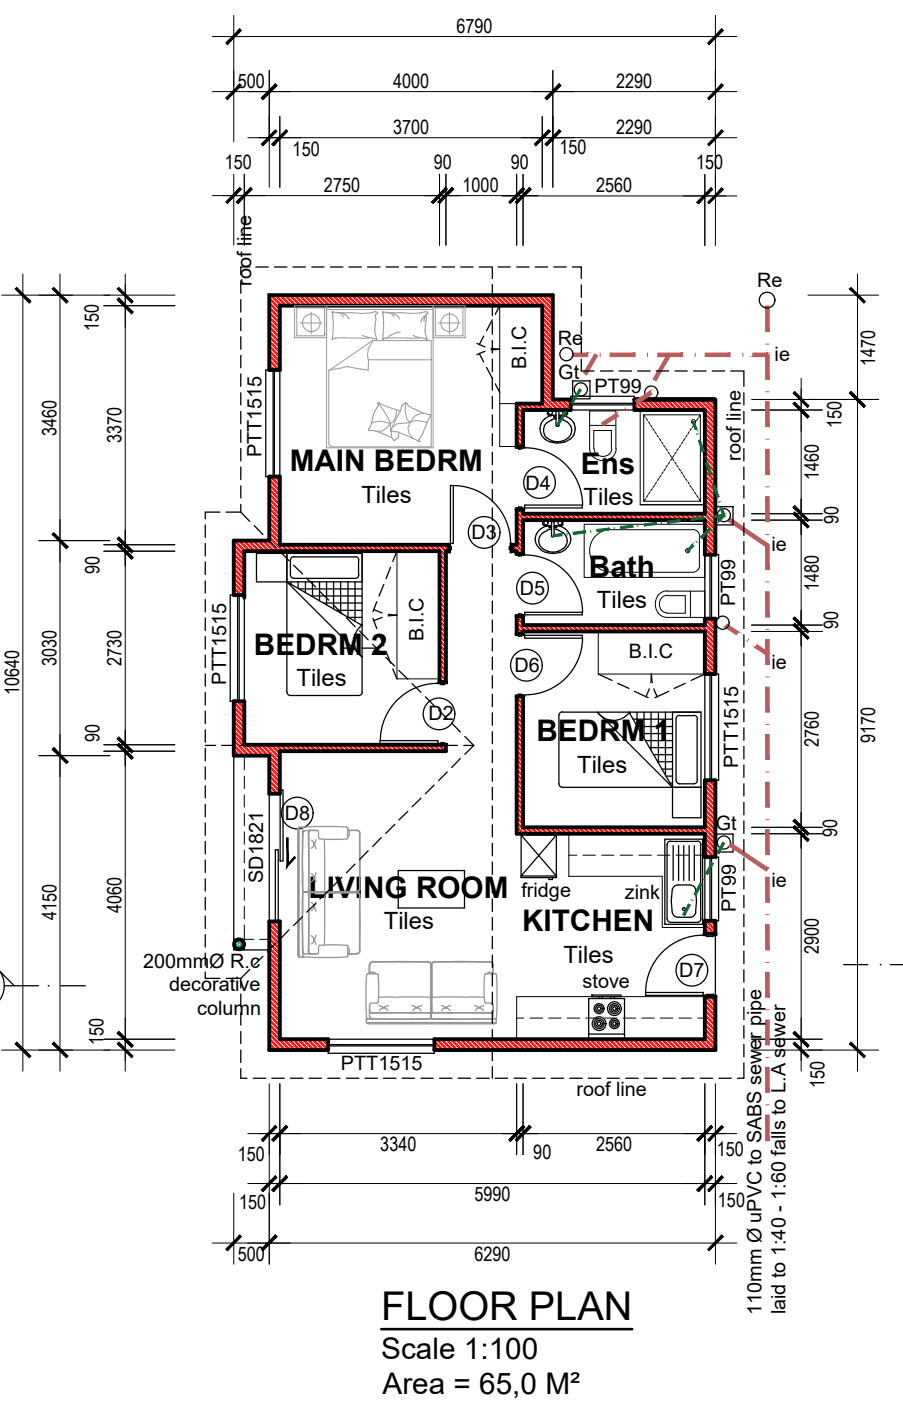

OCCUPANCY CLASSIFICATION OF BUILDING:

Occupancy	H4
Total Nett Floor Area	53,80 m ²
Total Floor Area	65,00 m ²
Design Occupancy Time	24hrs per day / 7 days per week
Building Orientation	NORTH
Climatic Zone	Springs

SANS 10400XA COMPLIANCE CALCULATIONS: DEEM TO SATISFY

Glazing Area:						
REF. NR.	WIDTH	HEIGHT	AREA	QTY	TTL AREA	
PT1515	1.500m	1.500m	2,25 m ²	4	9,00 m ²	
PT99	0.900m	0.900m	0,81 m ²	3	2,43 m ²	
SD1821	1.800m	2.100m	3,78 m ²	1	3,78 m ²	
Total Glazing			15,21 m ²			

CHECK FOR COMPLIANCE WITH SANS 10400XA CALCULATIONS

Nett Floor Area:	53,80 m ²
Glazing Area:	15,21 m ²

$(\text{glazing area} / \text{nett floor area}) \times 100 = \text{****}\% \leq 15\%$
 $(15,21 \text{ m}^2 / 53,80 \text{ m}^2) \times 100 = \text{28,27}\% \leq 15\%$

Do not comply with max 15% as per SANS 10400XA

Where the total area of the glazing elements of a storey is greater than 15% of the nett floor area of the storey, the requirements contained in SANS 204 shall be complied with.

HOT WATER SERVICES

Daily hot water usage	
Type of accommodation	Dwelling houses - Medium rental : 115-140 L/capita/day
No. of persons	4 per day
Assumed daily hot water consumption	560 L
Assumed annual hot water consumption	203,84 kL - based on daily design occupancy per week
50% of annual hot water consumption	101,92 kL - To be provided by means other than electrical heating

Conclusion:
 Dwelling to be provided with min 280L water vessel. Electrical and Solar heating system combination, installed by specialist and shall comply with SANS 1307, 10106, 10254 and SANS 10252-1

Insulation Requirements:	
Internal diameter of Hot water pipe	= 80
Min required R - value for Pipe insulation	1,0
Hot water Vessel / Tanks:	
Min required R - value for Vessel/ Tank	2,0

ENERGY CONSUMPTION: LIGHTING

ALLOWED:	5 W/m ²
CALCULATION:	Total Watt / Nett floor area = ****W/m ²

Lights in dwelling			
DESCRIPTION	QTY	TOTAL	
13W CF	07	91	
TOTAL:		91 W	

91 W / 53,80 m² = **1.691 W/m²** <S W/m²

DO COMPLY

ENERGY CONSUMPTION

ALLOWED: 5 kWh/m².a [a = 1 (year)]
 5 kWh/m².a x nett floor area = **** kWh.a
 5 kWh/m².a x 53,80m² = 269,00 kWh.a
 Max Allowed = 269,00 kWh.a

CALCULATION:
 ASSUMPTIONS:
 Assume lights lamps are on from 17:00 - 22:00 each day/year, that is 5 h/day
 -52 (weeks) x 7 (days) x 5 (hours) = 1820 h.a
 -91 W = 0,091kW
 0,091kW x 1820 h.a = 165,62 kWh.a [- 269,00 kWh.a]

DO COMPLY

ROOF ASSEMBLY:

SANS 10400 XA:	
Occupancy	H4
Design Occupancy Time	24hrs per day / 7 days per week
Climate Zone	Springs
Minimum R-value required	3,20 m ² K/W
Direction of heat flow	Up
CALCULATION	
Basic Roof Assembly	Concrete tiles
R - value for Metal Sheeting	0,3 m ² K/W
R-Value of Ceiling	0,05 m ² K/W
TOTAL R - Obtained	0,35 m ² K/W

Obtained R-Value => Minimum R-value required
Do Not Comply with SANS 10400 XA
 Additional Insulation required With at least R-Value of 2,85 m²K/W

SANS 204:	
Roof venting	Unventilated
Basic Roof Construction	Concrete tiles @ 17-20° pitch w/ plasterboard ceiling
Direction of heat flow	Up
Min R - value insulation required	2,85 m ² K/W
Additional Thermal Insulation	Flexible fibre glass blanket 10-18 kg/m ²



Conclusion:
 It's recommended that a Flexible fibre glass blanket, with a thickness of 115 mm needs to be installed in order to achieve the additional min R-value of 2,85 m²K/W

Buildings with a floor area of less than 500 m², with a concrete slab-on-ground, shall have insulation installed around the vertical edge of its perimeter which shall:

- have an R-value of not less than 1,0,
 - resist water absorption in order to retain its thermal insulation properties, and
 - be continuous from the adjacent finished ground level
- 1) to a depth of not less than 300 mm, or
 2) for the full depth of the vertical edge of the concrete slab-on-ground.

FLOOR PLAN

Scale 1:100 Area = 65,0 M²

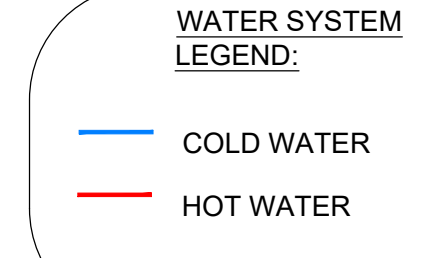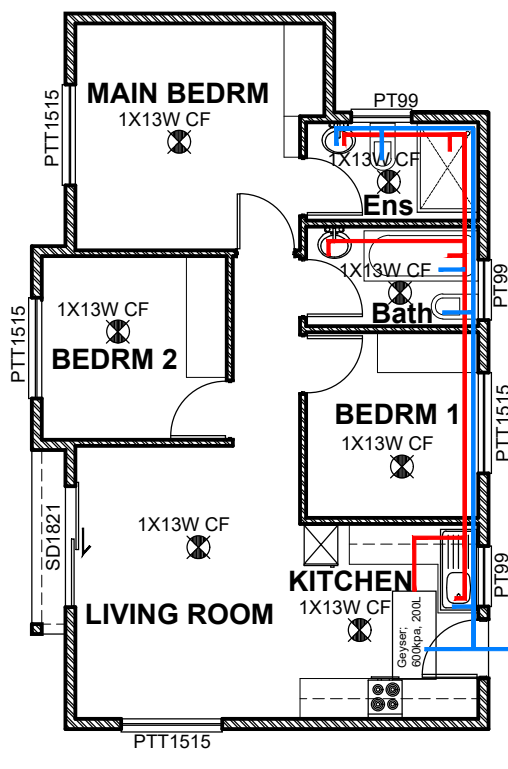


Hot Water Supply (As per SANS 10400 XA:2011)

4.5.2.1 A min. of 50 % by volume of the annual average hot water heating requirement shall be provided by means other than electrical resistance heating, including, but not limited to, solar heating, heat pumps, heat recovery from other systems or processes.
 4.5.2.2 The solar water heating systems shall comply with SANS 1307 and SANS 10106, based on the thermal performance determined in accordance with the provisions of SANS 6211-1 and SANS 6211-2. The installation thereof shall comply with SANS 10254.
 4.5.2.3 Hot water usage should be minimized and the system maintained in accordance with the requirements given in SANS 10252-1.
 4.5.2.4 All exposed pipes to and from the hot water cylinders and central heating systems shall be insulated with pipe insulation material with an R-value in accordance with table 13.
 4.5.2.5 Insulation shall a) be protected against the effects of weather and sunlight, b) be able to withstand the temperatures within the piping, and c) achieve the minimum total R-value given in table 25

Thermal Insulation: (As per SANS 10252-1: 2012)

Table 13 - Minimum R-value of pipe insulation	
1	2
Internal diameter of pipe mm	Minimum R-value*
≤ 80 mm	1,00
> 80 mm	1,50
* Determined with a hot surface temperature of 60 °C and an ambient temperature of 15 °C.	

4.5.2.6 Hot water vessels and tanks shall be insulated with a material achieving a minimum R-value of 2,0.
 NOTE To achieve this value, insulation in addition to the manufacturers' installed insulation may be required.
 4.5.2.7 Insulation on vessels, tanks and piping containing cooling water shall be protected by a vapour barrier on the outside of the insulation.
 4.5.2.8 The piping insulation requirements do not apply to space heating water piping a) located within the space being heated where the piping is to provide the heating to that space, or b) enclosed within a concrete floor slab or in masonry.
 These pipes shall comply with SANS 10252-1.
 4.5.2.9 Piping to be insulated includes all flow and return piping, cold water supply piping within 1 m of the connection to the heating or cooling system and pressure relief piping within 1 m of the connection.



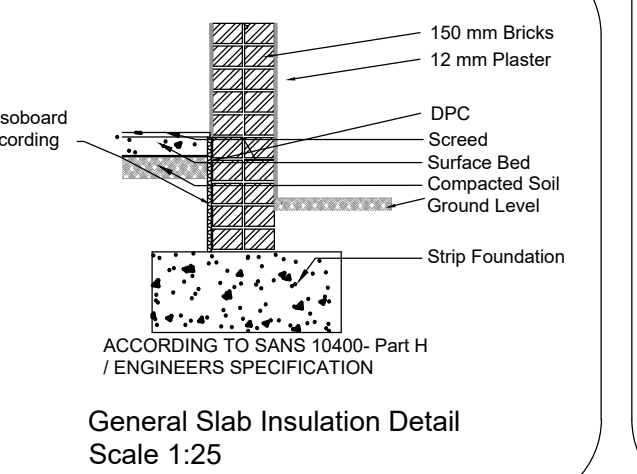


General Slab Insulation Detail Scale 1:25

EXTERNAL WALL CONSTRUCTION



SANS 10400 Table 3 - Minimum CR-value, in hours, for external walling			
Wall type	Masonry: Single masonry wall, plastered internally and externally		
Minimum CR-value	80 hrs		
Minimum R-value required	0,35		
CALCULATION			
External Plasterwork	Conductivity (W/m°C)	Thickness (m)	Resistivity (m ² K/W)
Brickwork	0,6	0,015	0,03
Internal Plaster	0,7	0,230	0,33
	0,6	0,015	0,03
Total R-value Achieved 0,39			

Conclusion:
 Wall complies with minimum R-value of 0,35 for external walls

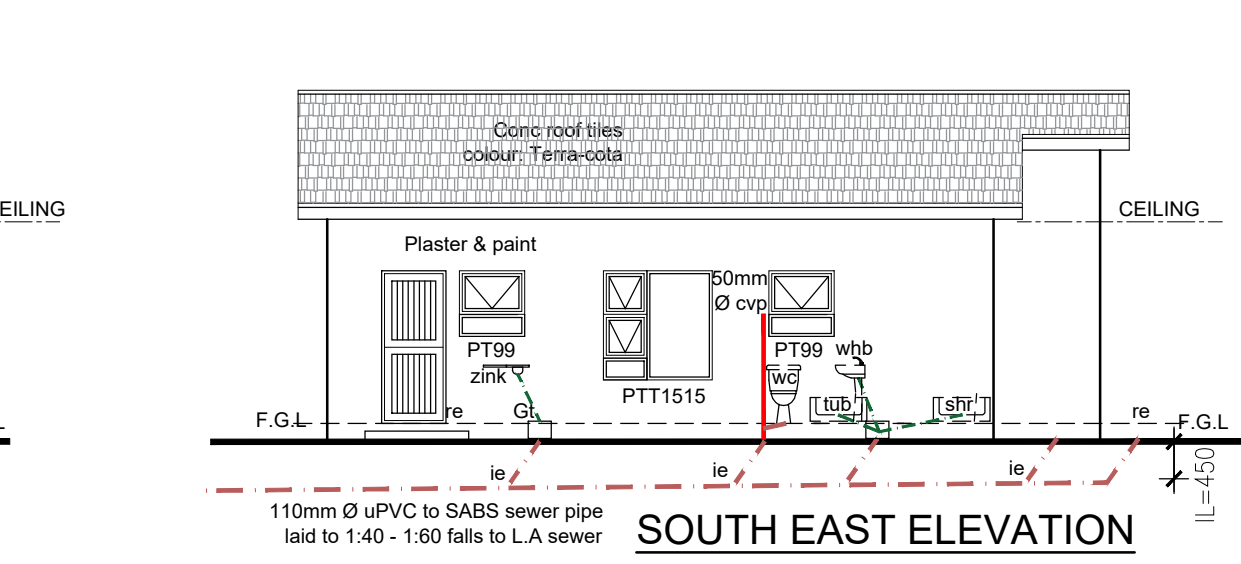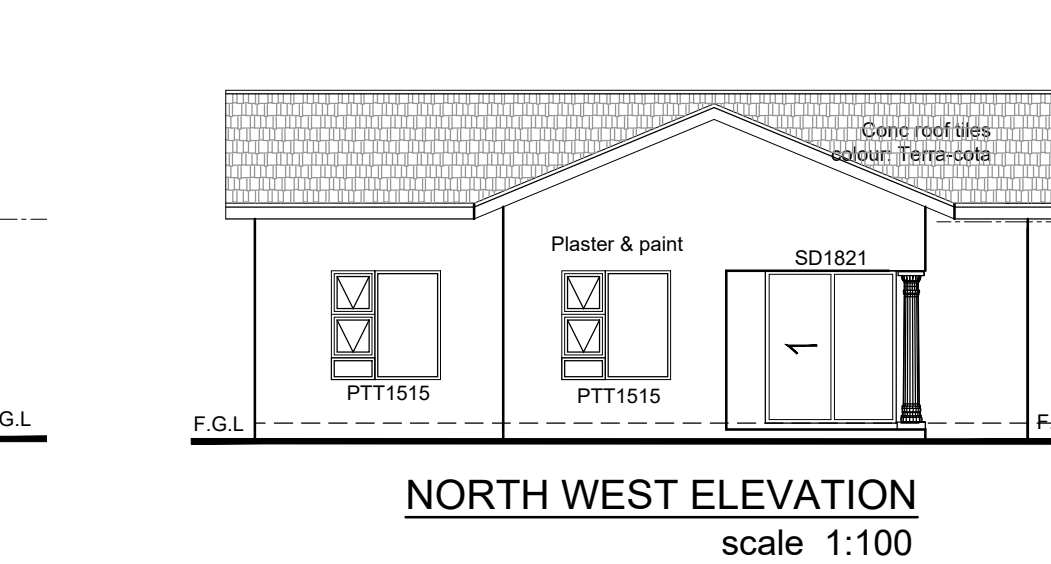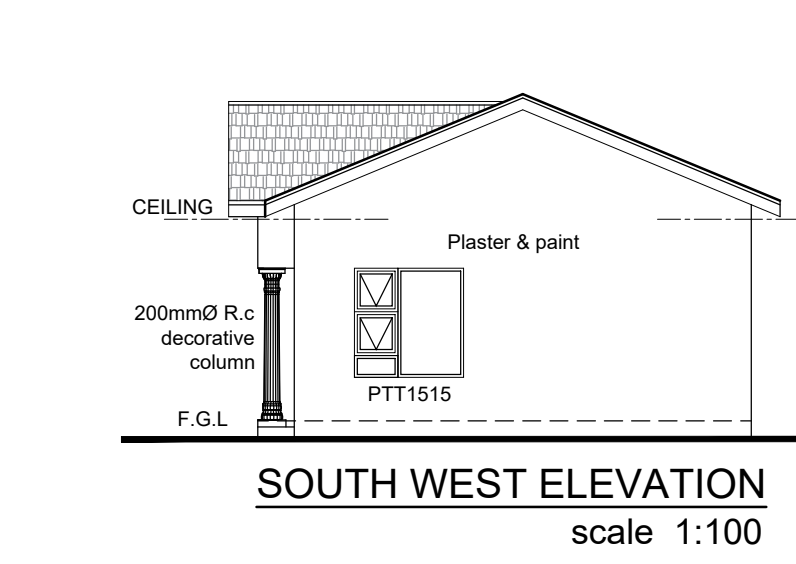

AREA SCHEDULE

ROOM	AREA M ²
LIVING ROOM	13,4 M ²
KITCHEN	7,7 M ²
MAIN BEDROOM	11,5 M ²
BEDROOM 1	6,8 M ²
BEDROOM 2	7,3 M ²
BATHROOM	3,6 M ²
ENSUITE	3,5 M ²
WALLS/PASSAGE	11,2 M ²
TOTAL	65,0 M ²
TTL FL. = 65,0 M ²	
Stand Area = 250 M ²	
Coverage = 26,0 %	

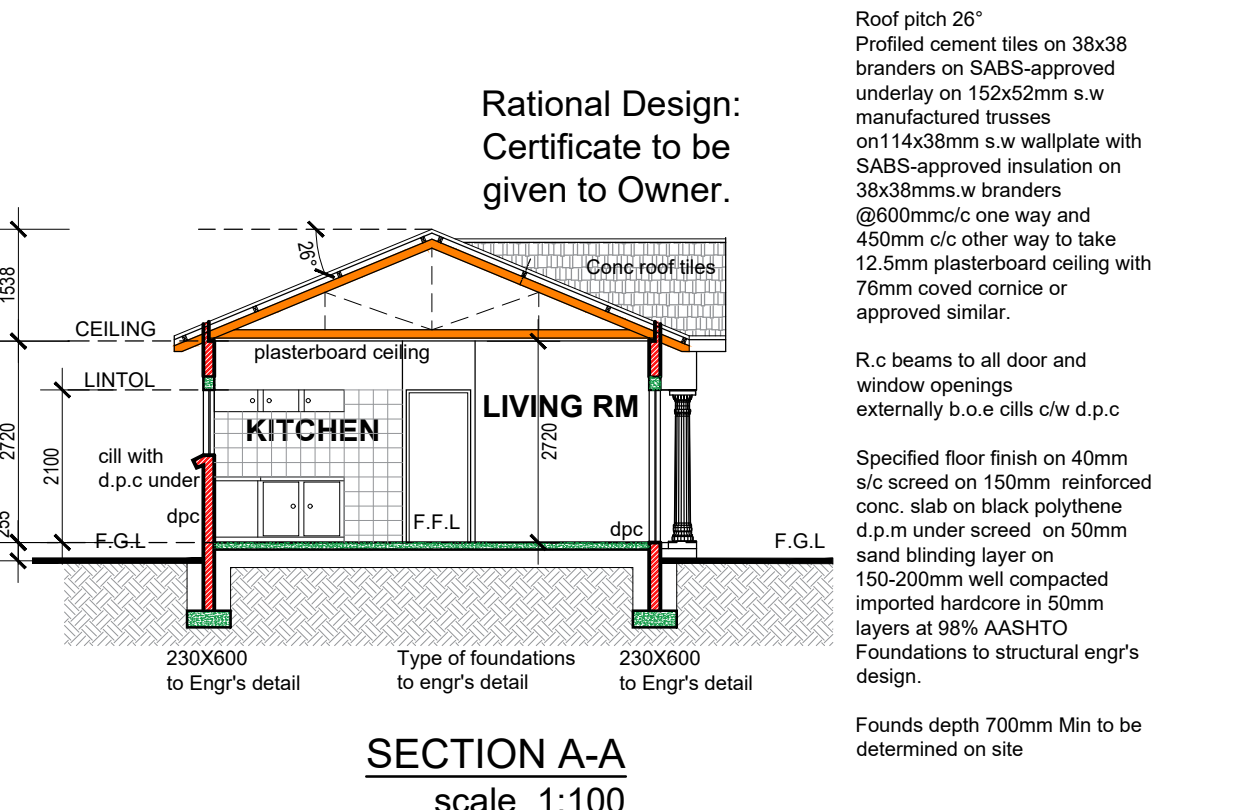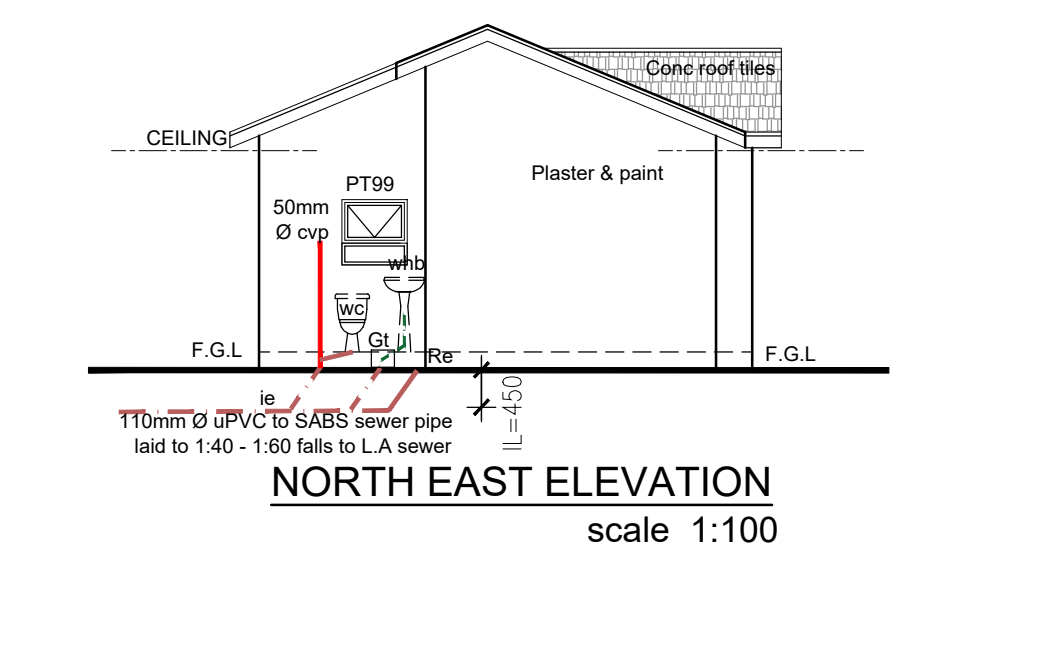

SECTION A-A scale 1:100

GENERAL NOTES:

- Contractor Notes:
 - No construction may proceed on site prior to the approval of drawings by the local authority. Any building work that commences prior to the building plan approval is completely at the owner's own risk.
 - The Architect may not be held responsible for any loss or damage whatsoever that may result from building works without approved building plans.
 - Contractor to verify all levels, heights and dimensions on site and to check same against the drawings before putting any work in hand. Levels are approximate and must be verified by the Contractor prior to and during construction. Relative floor levels will be determined after installation of master datum.
 - Any discrepancies on drawings must be pointed out by the Contractor to the Architect prior to construction.
 - Contractor is responsible for correct setting out of the buildings, all external walls with particular reference to boundaries, building lines, etc. Any errors, discrepancies or omissions to be reported to the Architect immediately.
 - Contractor responsible to engage Building Inspector on each Construction Stage, to get full satisfaction in compliance with Local Authority by-law and regulations. - Burnt clay bricks only shall be used unless specific approval is obtained from the Architect alternative type of bricks.
 - Conditions: The civil/structural engineer is responsible for soil test.
- Certificates required:
 - The following certificates of compliance to SABS and NBR standards may be required from the Contractor by the Architect:
 - FOUNDATION CERTIFICATE: Engineer.
 - DPC: Council Inspector.
 - ELECTRICAL INSTALLATION: Specialist Sub-contractor.
 - PLUMBING AND DRAINAGE: Specialist Sub-contractor.
 - ROOF STRUCTURE: Specialist Sub-contractor and/or Engineer.
 - TRAFFIC AND ROAD MARKINGS: Engineer.
 - FIRE SAFETY CERTIFICATE: Specialist and/or Council.
 - CONCRETE SLABS: Specialist Sub-contractor.
 - WATERPROOFING: Specialist Sub-contractor.
 - GLAZING: Specialist Sub-contractor.

CALCULATION SHEET:
 1. SANS 10400 XA
 2. SANS 204
 3. ENERGY CONSUMPTION: LIGHTING ENERGY DEMAND
 4. HOT WATER SERVICES/ SUPPLY
 5. EXTERNAL WALL CONSTRUCTION
 5.1 ALTERNATIVE WALL CONSTRUCTION
 6. ROOF ASSEMBLY
 7. UNDER FLOOR HEATING

ALL CALCULATIONS ARE BASED ON THE DRAWING DESIGNS AND WINDOWS SCHEDULES.
 ANY CHANGE ON SITE WILL HAVE AN EFFECT ON THE CALCULATIONS.

BEFORE ANY CHANGES, THE PLANNED CHANGES MUST BE RECALCULATED TO ENSURE COMPLIANCE WITH SANS 10400XA AND SANS 204 AND OTHER REFERRED SANS COMPLIANCE REQUIREMENTS.

RESPONSIBILITY
 THE OWNER ACCEPTS ALL RESPONSIBILITY FOR NONE COMPLIANCE TO SANS 10400XA AND SANS 204. SHOULD THERE BE ANY DEVIATION FROM THE DESIGNED PLAN, ONCE THE PLAN IS APPROVED BY THE LOCAL MUNICIPALITY.

THE COMPLETED FORMS TO BE SUBMITTED TO THE LOCAL MUNICIPALITY.

ISSUED FOR COUNCIL APPROVAL	
REV. NO.	DESCRIPTION:
REVISIONS	
SIZE ON ORIGINAL DRAWING 100 mm	

client

Client Approval

Sign Date



Project
Proposed Residence On Portion 3 of ERF 1096 Lepspreu St Sharon Park Lifestyle Estate Ext 2 T/Ship

Status
FOR APPROVAL

Drawing
Plans, Elevations & Sections

Checked
 DT (SACAP) ST2553

Scale
 as shown

DRWG No.
TP132-01

Date
Oct 2022