


A1


WINDOW SCHEDULE			
TYPE "A"	TYPE "B"		
TYPE: PTT1515	TYPE: PT99		
QTTY: FIVE (05)	QTTY: THREE (03)		
LOCATION	ORIENTATION	LOCATION	ORIENTATION
LIVING ROOM	S EAST & N EAST ELEV	BATHROOM	SOUTH WEST ELEVATION
MAIN BEDROOM	NORTH EAST ELEVATION	KITCHEN	SOUTH WEST ELEVATION
BEDROOM 1	SOUTH WEST ELEVATION	ENSUITE	NORTH WEST ELEVATION
BEDROOM 2	NORTH EAST ELEVATION		
FRAME DESCRIPTION		FRAME DESCRIPTION	
STANDARD ANODIZED ALUM. FRAME COMPLETE WITH BEADING. WINDOW FRAMES TO BE FITTED AFTER THE BRICKWORK. ALL AS PER THE MANUF. SPECS.		STANDARD ANODIZED ALUM. FRAME COMPLETE WITH BEADING. WINDOW FRAMES TO BE FITTED AFTER THE BRICKWORK. ALL AS PER THE MANUF. SPECS.	
FINISH		FINISH	
ANODIZED.		ANODIZED.	
GLAZING		GLAZING	
ALL GLASS PANE TO BE SAFETY GLASS AS PER SANS 10400 PART N. 6MM CLEAR TOUGHENED SAFETY GLASS BEADINGS TO BE USED TO FIX GLASS INTO POSITION.		ALL GLASS PANE TO BE SAFETY GLASS AS PER SANS 10400 PART N. 6MM CLEAR/OBSCURE TOUGHENED SAFETY GLASS BEADINGS TO BE USED TO FIX GLASS INTO POSITION.	

DOOR SCHEDULE							
DOOR TYPE:	TYPE "A"	TYPE "B"	TYPE "C"	TYPE "D"			
WALL	150mm BRICKWALL	150mm BRICKWALL	150mm BRICKWALL	150mm BRICKWALL			
REF. NO	D01	D02	D03	D04	D05	D06	D07
LOCATION	LIVING ROOM	BEDROOM 2	MAIN BEDROOM	ENSUITE	BATHROOM	BEDROOM 1	KITCHEN
HAND	LH	LH	LH	RH	RH	LH	LH
NO. REQ	ONE (01)	FIVE (05)	ONE (01)	ONE (01)			
FRAME	GALV. PRESSED STEEL DOOR FRAME. 1.6mm THICK FOR 150mm WALL.	GALV. PRESSED STEEL DOOR FRAME. 1.6mm THICK FOR 150mm WALL.	GALV. PRESSED STEEL DOOR FRAME. 1.6mm THICK FOR 150mm WALL.	STANDARD ANODIZED ALUM. FRAME WITH BEADING. FRAMES FITTED AFTER BRICKWORK.			
LEAF	813 x 2032 x 44mm SALIGNA BLACO HARDWOOD SINGLE LEAF DOOR.	813 x 2032 x 44mm SEMI SOLID CORE FLUSH PANEL DOOR WITH HARDWOOD EDGINGS.	813 x 2032 x 44mm SOLID CORE STABLE DOOR.	1800 x 2100 SLIDING DOOR.			
FINISH	SANDED & 3 COATS OF CLEAR VANISH.	1 CT PINK WIPPRIMER & 2 CTS SUPER ENAMEL	SANDED & 3 COATS OF CLEAR VANISH.	9mm CLEAR SAFETY GLASS (SANS 10400 PART N)			
I/MONGERY	1. DOVE LEVER HANDLES L. 2. LEVER MORTICE LOCKSET.	1. DOVE LEVER HANDLES L. 2. LEVER MORTICE LOCKSET.	1. DOVE LEVER HANDLES L. 2. LEVER MORTICE LOCKSET.				

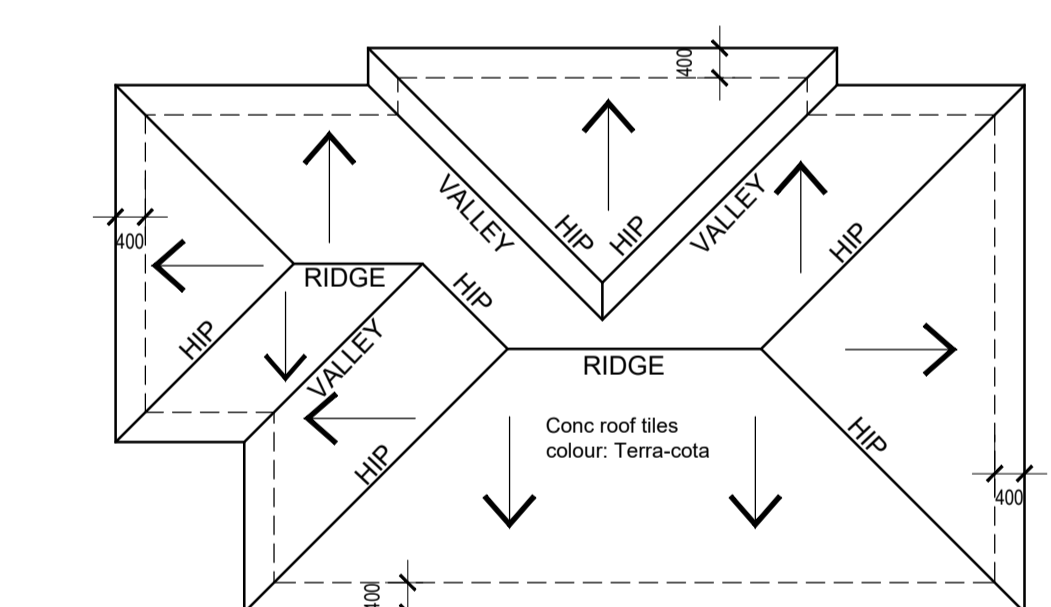

ROOM	AREA M ²
LIVING ROOM	16,1 M ²
KITCHEN	7,8 M ²
MAIN BEDROOM	11,6 M ²
BEDROOM 1	7,3 M ²
BEDROOM 2	7,7 M ²
BATHROOM	4,5 M ²
ENSUITE	4,0 M ²
WALLS/PASSAGE	12,4 M ²
TOTAL	70,0 M²

TTL FL. = 70,0 M²
Stand Area = 249 M²
Coverage = 28,1 %

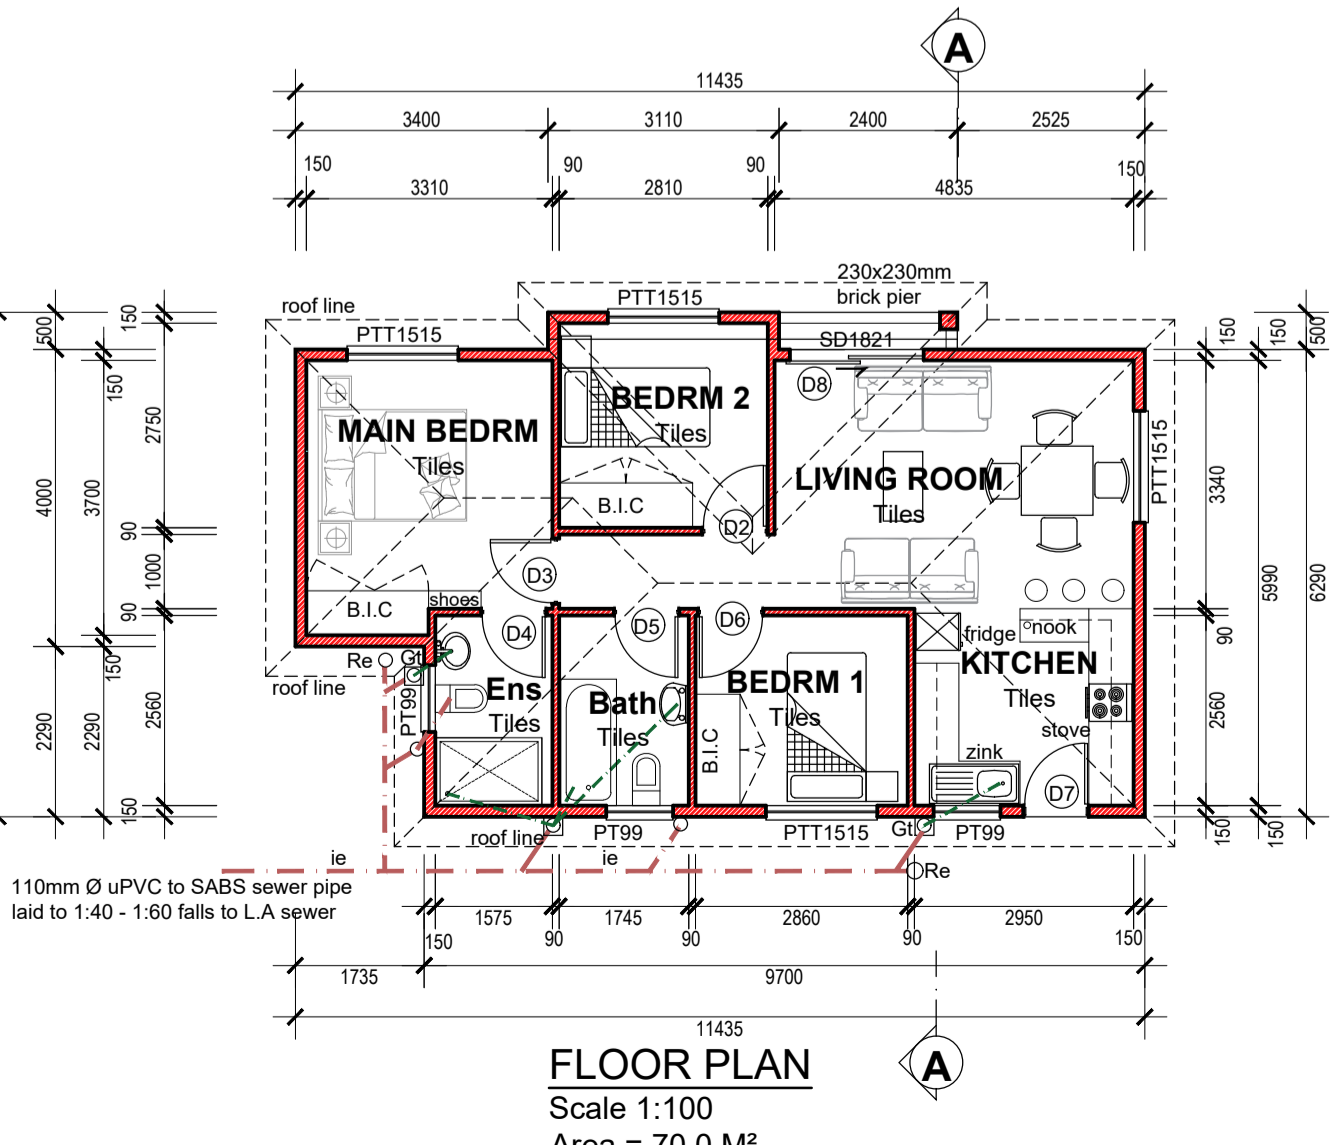

FLOOR PLAN
Scale 1:100
Area = 70,0 M²

ENERGY DEMAND		
ALLOWED:	5 W/m ²	
CALCULATION:	Total Watt / Net floor area = ****W/m ²	
Lights in dwelling	QTY	TOTAL
13W CF	06	78
TOTAL: 78 W		
78 W / 43,10 m ² = 1,809 W/m² [< 5 W/m ²]		

OCCUPANCY CLASSIFICATION OF BUILDING:				
Occupancy	H4			
Total Nett Floor Area	43,10 m ²			
Total Floor Area	50,00 m ²			
Design Occupancy Time	24hrs per day / 7 days per week			
Building Orientation	NORTH			
Climatic Zone	Springs			

SANS 10400XA COMPLIANCE
CALCULATIONS: DEEM TO SATISFY

REF NR.	WIDTH	HEIGHT	AREA	QTY/TTL AREA
PT1515	1.500m	1.500m	2.25 m ²	4 9.00 m ²
PT99	0.900m	0.900m	0.81 m ²	3 2.43 m ²
SD1821	1.800m	2.100m	3.78 m ²	1 3.78 m ²
Total Glazing			6.84 m ²	15.21 m ²

CHECK FOR COMPLIANCE WITH SANS 10400XA
CALCULATIONS

Nett Floor Area:	43.10 m ²
Glazing Area:	11.43 m ²

(glazing area / nett floor area) x 100 = ****% [< 15%]
(11.43 m² / 43.10 m²) x 100 = 26,52% [> 15%]


Do Not comply with max 15% as per SANS 10400XA
(The total area of the glazing elements of a storey is greater than 15% of the nett floor area of the storey the requirements contained in SANS 204 shall be complied with.)

HOT WATER SERVICES


Daily hot water usage	Dwelling houses - Medium rental : 115-140 L/capita/day
Type of accommodation	
No. of persons	4 per day
Assumed daily hot water consumption	560 L
Assumed annual hot water consumption	203.84 kL - based on daily design occupancy per week
50% of annual hot water consumption	101.92 kL - To be provided by means other than electrical heating

Conclusion:
Dwelling to be provided with min 280L water vessel. Electrical and Solar heating system combination, installed by specialist and shall comply with SANS 1307, 10106, 10254 and SANS 10252-1


Insulation Requirements:	
Internal diameter of Hot water pipe	= 80
Min required R - value for Pipe insulation	1.0
Hot water Vessel / Tanks:	
Min required R - value for Vessel / Tank	2.0

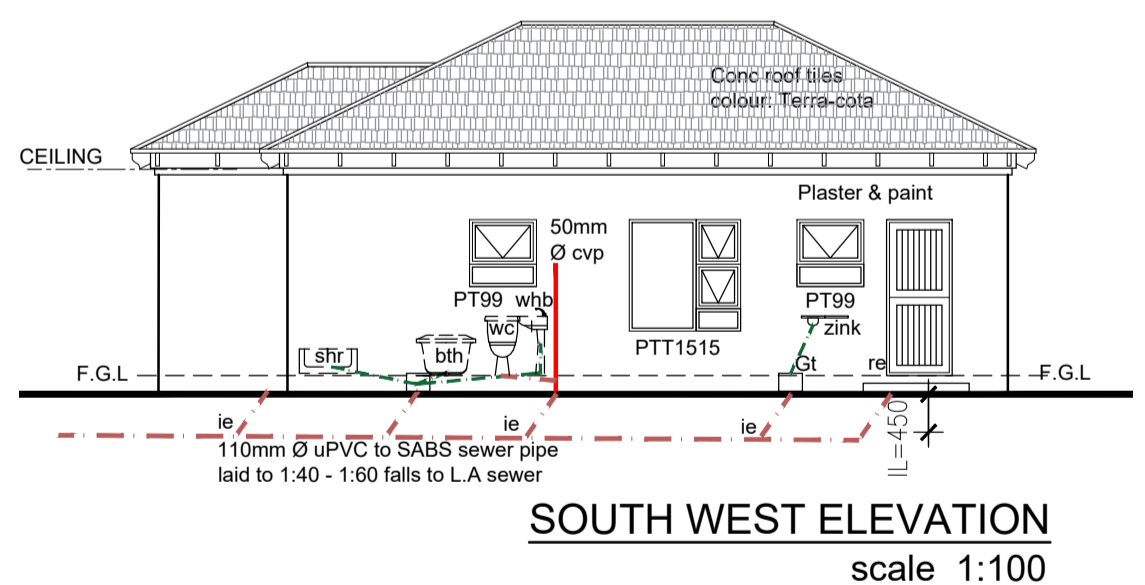


SOUTH WEST ELEVATION
scale 1:100

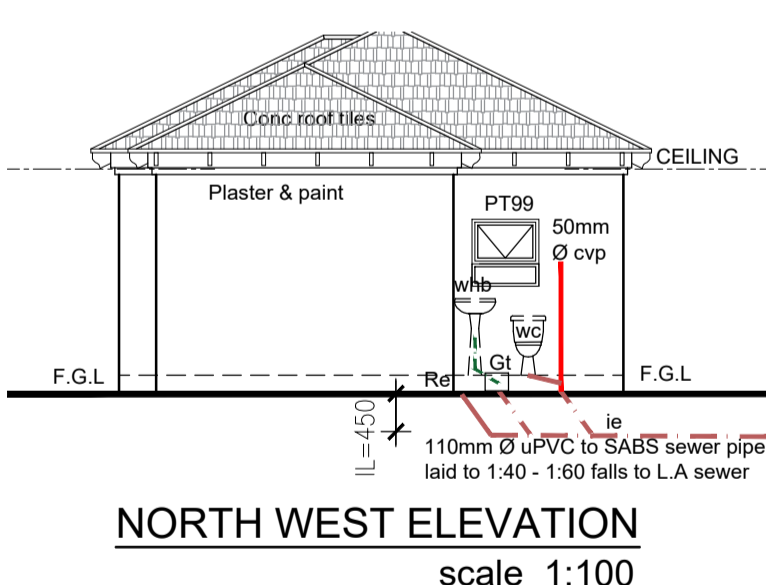

NORTH WEST ELEVATION
scale 1:100

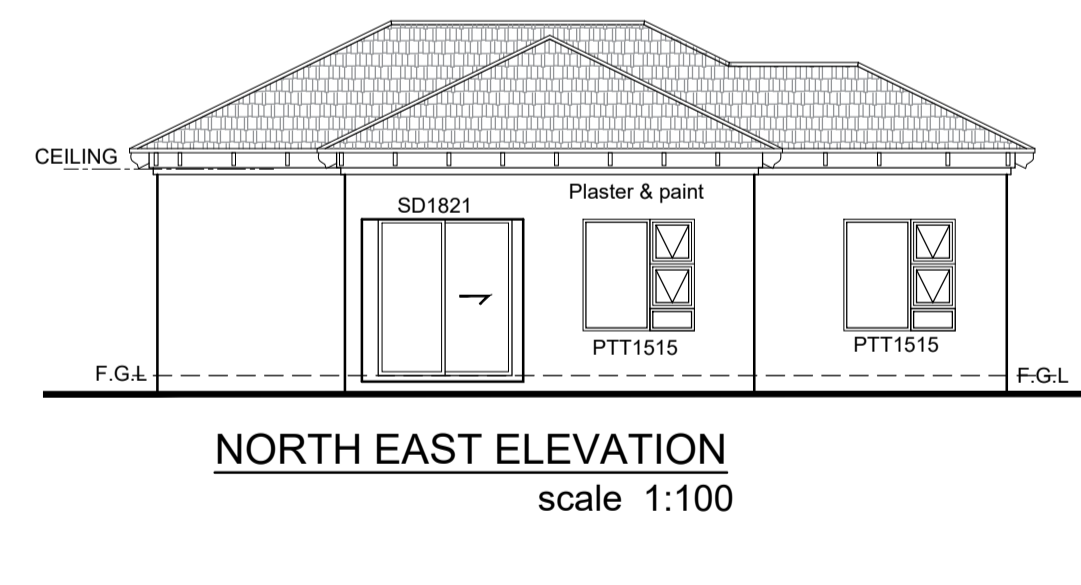


NORTH EAST ELEVATION
scale 1:100

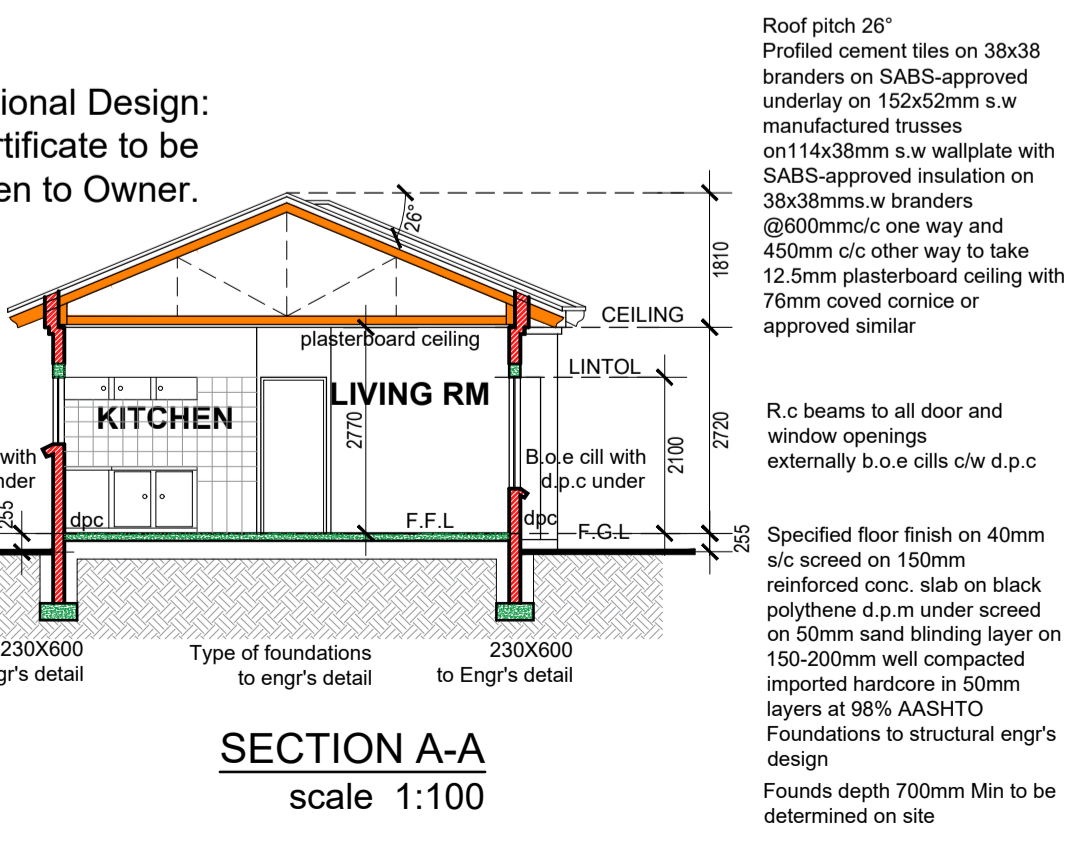

SECTION A-A
scale 1:100

Rational Design: Certificate to be given to Owner.

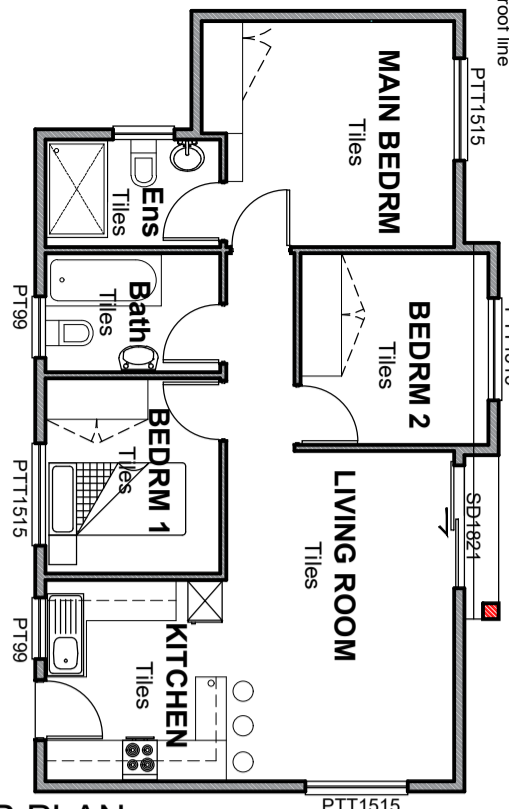

FLOOR PLAN
Scale 1:100
Area = 70,0 M²

ENERGY CONSUMPTION: LIGHTING
ENERGY DEMAND
ALLOWED: 5 W/m²
CALCULATION:
Total Watt / Net floor area = ****W/m²

ENERGY DEMAND		
ALLOWED:	5 W/m ²	
CALCULATION:	Total Watt / Net floor area = ****W/m ²	
Lights in dwelling	QTY	TOTAL
13W CF	06	78
TOTAL: 78 W		
78 W / 43,10 m ² = 1,809 W/m² [< 5 W/m ²]		

DO COMPLY

ENERGY CONSUMPTION
ALLOWED: 5 kWh/m² a [a = 1 year]
5 kWh/m² a x nett floor area = ****kWh.a
5 kWh/m² a x 43,10m² = 215,50 kWh.a
Max Allowed = 215,50 kWh.a

CALCULATION:	
ASSUMPTIONS:	Assume lights lamps are on from 17:00 - 22:30 each day, that is 5 h/day
	-52 (weeks) x 7 (days) x 5 (hours) = 1820 h.a
	-78 W = 0,078 kW
	0,078 kW x 1820 h.a = 141,96 kWh.a [< 215,50 kWh.a]

DO COMPLY

ROOF ASSEMBLY:

SANS 10400 XA:	
Occupancy	H4
Design Occupancy Time	24hrs per day / 7 days per week
Climatic Zone	Springs
Minimum R-value required	3,20 m ² /K/W
Direction of heat flow	Up

CALCULATION	
Basic Roof Assembly	Concrete tiles
R-value for Metal Sheeting	0,3 m ² /K/W
R-value of Ceiling	0,05 m ² /K/W
TOTAL R - Obtained	0,35 m ² /K/W

Obtained R-Value => Minimum R-value required
Do Not Comply with SANS 10400 XA
Additional Insulation required With at least R-Value of 2,85 m²/K/W

SANS 204:	
Roof venting	Unventilated
Basic Roof Construction	Concrete tiles @ 17-20" pitch w/ plasterboard ceiling
Direction of heat flow	Up
Min R - value insulation required	2,85 m ² /K/W
Additional Thermal Insulation	Flexible fibre glass blanket 10-18 kg/m ²

Conclusion:
It's recommended that a Flexible fibre glass blanket, with a thickness of 115 mm needs to be installed in order to achieve the additional min R-value of 2,85 m²/K/W

WATER SYSTEM LEGEND:	
	COLD WATER
	HOT WATER

EXTERNAL WALL CONSTRUCTION	
SANS 10400 Table 3 - Minimum CR-value, in hours, for external walling	
Wall type	Masonry: Single masonry wall, plastered internally and externally
Minimum CR-value	80 hrs
Minimum R-value required	0,35
CALCULATION	
External Plasterwork	Conductivity (W/m . C) 0,6 Thickness (m) 0,015 Resistivity (m ² /KW) 0,03
Brickwork	Conductivity (W/m . C) 0,7 Thickness (m) 0,230 Resistivity (m ² /KW) 0,33
Internal Plaster	Conductivity (W/m . C) 0,6 Thickness (m) 0,015 Resistivity (m ² /KW) 0,03
Total R-value Achieved 0,39	

Conclusion:
Wall complies with minimum R-value of 0,35 for external walls

Hot Water Supply (As per SANS 10400 XA:2011)


4.5.2.1 A min. of 50 % by volume of the annual average hot water heating requirement shall be provided by means other than electrical resistance heating, including, but not limited to, solar heating, heat pumps, heat recovery from other systems or processes.
4.5.2.2 The solar water heating systems shall comply with SANS 1307 and SANS 10106, based on the thermal performance determined in accordance with the provisions of SANS 6211-1 and SANS 6211-2. The installation thereof shall comply with SANS 10254.
4.5.2.3 Hot water usage should be minimized and the system maintained in accordance with the requirements given in SANS 10252-1.
4.5.2.4 All exposed pipes to and from the hot water cylinders and central heating systems shall be insulated with pipe insulation material with an R-value in accordance with table 13.
4.5.2.5 Insulation shall a) be protected against the effects of weather and sunlight, b) be able to withstand the temperatures within the piping, and c) achieve the minimum total R-value given in table 25

Thermal Insulation: (As per SANS 10252-1: 2012)
Table 13 - Minimum R-value of pipe insulation

Internal diameter of pipe mm	Minimum R-value*
≤ 80 mm	1,00
> 80 mm	1,50

* Determined with a hot surface temperature of 60 °C and an ambient temperature of 15 °C.


4.5.2.6 Hot water vessels and tanks shall be insulated with a material achieving a minimum R-value of 2.0.
NOTE To achieve this value, insulation in addition to the manufacturers' installed insulation may be required.
4.5.2.7 Insulation on vessels, tanks and piping containing cooling water shall be protected by a vapour barrier on the outside of the insulation.
4.5.2.8 The piping insulation requirements do not apply to space heating water piping a) located within the space being heated where the piping is to provide the heating to that space, or b) enclosed within a concrete floor slab or in masonry.
These pipes shall comply with SANS 10252-1.
4.5.2.9 Piping to be insulated includes all flow and return piping, cold water supply piping within 1 m of the connection to the heating or cooling system and pressure relief piping within 1 m of the connection.

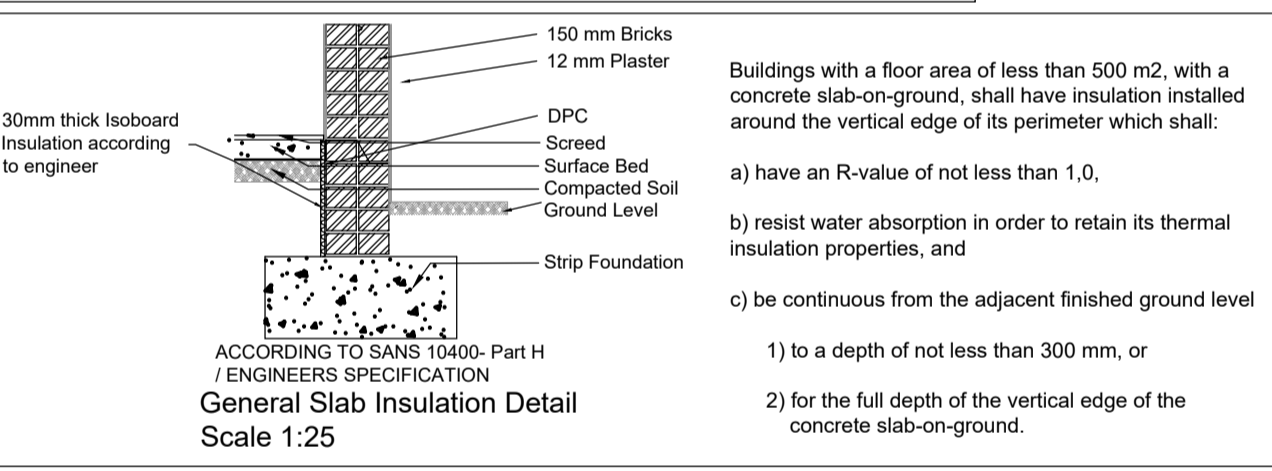

Buildings with a floor area of less than 500 m², with a concrete slab-on-ground, shall have insulation installed around the vertical edge of its perimeter which shall:

- a) have an R-value of not less than 1,0,
- b) resist water absorption in order to retain its thermal insulation properties, and
- c) be continuous from the adjacent finished ground level

- 1) to a depth of not less than 300 mm, or
- 2) for the full depth of the vertical edge of the concrete slab-on-ground.

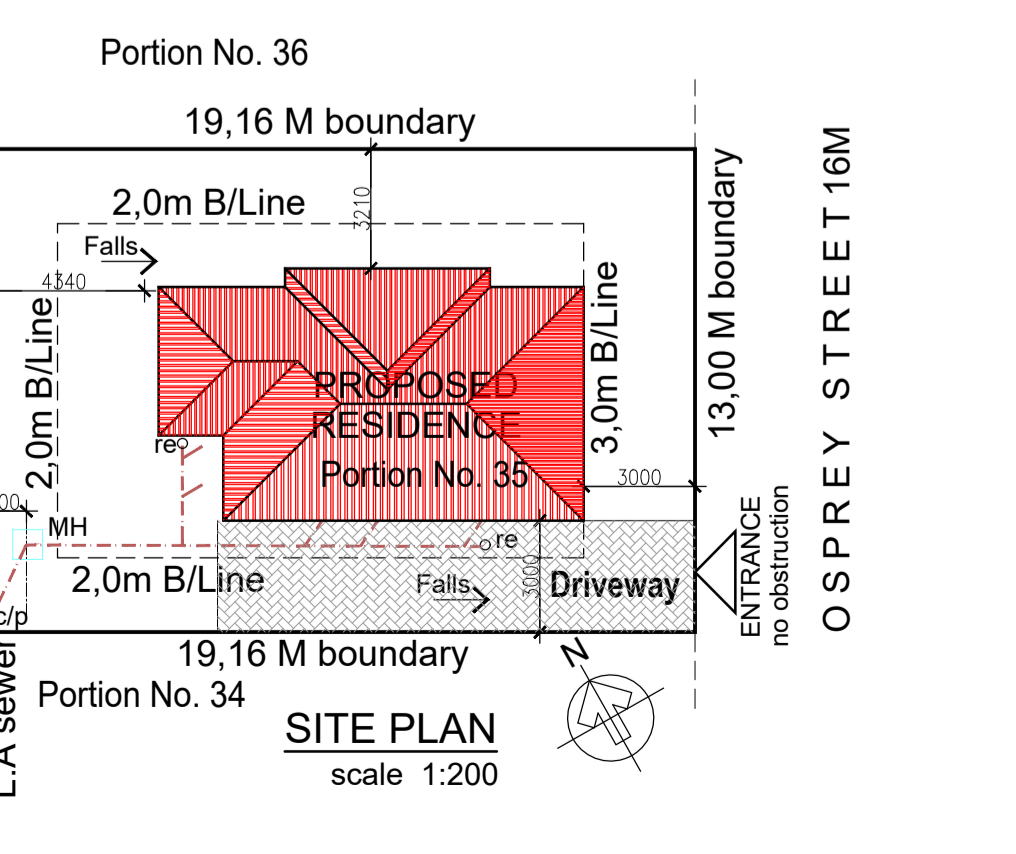

SITE PLAN
scale 1:200

GENERAL NOTES:

- Contractor Notes:**
 - No construction may proceed on site prior to the approval of drawings by the local authority. Any building work that commences prior to the building plan approval is completely at the owner's own risk.
 - The Architect may not be held responsible for any loss or damage whatsoever that may result from building works without approved building plans.
 - Contractor to verify all levels, heights and dimensions on site and to check same against the drawings before putting any work in hand. Levels are approximate and must be verified by the Contractor prior to pricing and construction. Relative floor levels will be determined after installation of master datum.
 - Any discrepancies on drawings must be pointed out by the Contractor to the Architect prior to construction.
 - Contractor is responsible for correct setting out of the buildings, all external walls with particular reference to boundaries, building lines, etc. Any errors, discrepancies or omissions to be reported to the Architect immediately.
 - Contractor responsible to engage Building Inspector on each Construction Stage, to get full satisfaction in compliance with Local Authority by-law and regulations. - Burnt clay bricks only shall be used unless specific approval is obtained from the Architect alternative type of bricks.
 - Conditions: The civil/structural engineer is responsible for soil test.
- Certificates required:**
 - The following certificates of compliance to SABS and NBR standards may be required from the Contractor by the Architect:
 - FOUNDATION CERTIFICATE: Engineer.
 - DPC: Council Inspector.
 - PLUMBING AND DRAINAGE: Specialist Sub-contractor.
 - ELECTRICAL INSTALLATION: Specialist Sub-contractor.
 - TRAFFIC AND ROAD MARKINGS: Engineer.
 - FIRE SAFETY CERTIFICATE: Specialist and/or Council.
 - ROOF STRUCTURE: Specialist Sub-contractor and/or Engineer.
 - CONCRETE SLABS: Specialist Sub-contractor.
 - WATERPROOFING: Specialist Sub-contractor.
 - GLAZING: Specialist Sub-contractor.
- Materials and Finishes Notes:**
 - All finishing products such as window frames, roof, tiles, cornices, etc. must be approved by the Architect before ordering and installation.
 - All product used must comply with SABS Standards and Local Authority Requirements.
 - Quality of all materials and workmanship to comply with the relevant SABS and SANS specifications and shall conform to the Standards specified in the Standard Prescribes in the Bill of Materials available for perusal at the Architect's office.
 - Contractor is to build in approved DPC's whether or not these are shown on drawings to all external walls at each floor, beam or parapet level and to all window, door, grill or other opening in external walls. All partitions to comply with SABS 082 on NBR.
 - Building Standard Notes:**
 - All works must comply to the National Building Regulations and applicable SABS and NBR/BC standards.
 - Drawings may not be scaled for construction purposes. Figured dimensions to be used at all times.
 - All drawings must be read in conjunction with one another.
 - Notes reflected on drawings apply for the entire project and works.
 - Any discrepancies on drawings must be pointed out by the Contractor to the Architect prior to construction and submission of tenders. If in doubt ask the Architect.
 - Contractor are to ensure that all details shown on this drawing are compliance with local authority by-law and regulations.
 - Contractor are to locate and identify existing services on site and to protect these from damage throughout the duration of the works.
- Glazing Notes:**
 - All glazing to comply with NBR (SANS 10400 - Part N) SABS 0137 & AAMSA.
 - Dimensions
 - Nominal glass thickness
 - Max. Size Pane
 - 4mm 0,75
 - 6mm 1,50
 - 8mm 2,10
 - 9mm 3,20
 - Any pane of glass installed in any door shall be safety glass and shall have a nominal thickness of not less than 6mm and does not likely to be apparent to any person approaching them shall bear markings. Any glass lower than 500mm from floor finish shall be safety glass. Any window staircases must be safety glass.
 - Flashing Notes:** Provide 0.6mm flashing at all parapets and areas where the roof line changes.
 - Brickwork Expansion Joints Notes:** Refer to Engineer for brickwork expansion joints.
 - Revisions:** Refer to drawing list for latest revisions on drawings.
 - Any queries arising from all the above must be reported to the Architect for clarification before any work is put in hand.

REV. NO.	DATE	DESCRIPTION
A	14.07.2022	ISSUED FOR COUNCIL APPROVAL

REVISIONS
SIZE ON ORIGINAL DRAWING: 100 mm

Client Approval: _____ Date: _____

Sign: _____ Date: _____



Project: Proposed Residence On Portion 35 of ERF 1428 Sharon Park Lifestyle Estate Ext 2 T/Ship

Status: FOR APPROVAL

Drawing: Plans, Elevations & Sections
Checked: DT (SACAP) ST2553
REG. NO. (SACAP) ST2553

DRWG No. TP129-01
Scale: as shown
Date: Sept 2022